

OPERATING PROCEDURE BLDG 51 HYDRAUGER FILTER SYSTEM OPERATION

APPLICATION


Maintenance that must be performed on the Bldg 51/64 hydrauger filter system.

SPECIAL INSTRUCTIONS

- Personnel using this procedure must have knowledge of hydrauger/filter systems.

WORK STEPS

1. The Earth Sciences technician performing tests will inform PMTs when replacement of these filters is required.
2. Disconnect the carbon filter container and remove it from the system.
3. Plug and seal the inlet and outlet on top of the container.
4. The used carbon filter container is hazardous waste. Take it to the Bldg 81 Waste Accumulation Area and label it as hazardous waste. EH&S disposes of this waste, and keeps records of test results and used containers.
5. Connect a new carbon filter container to the system.
6. Wait until flow is restored through the new container and into the storm drain.
7. Log date of replacement.

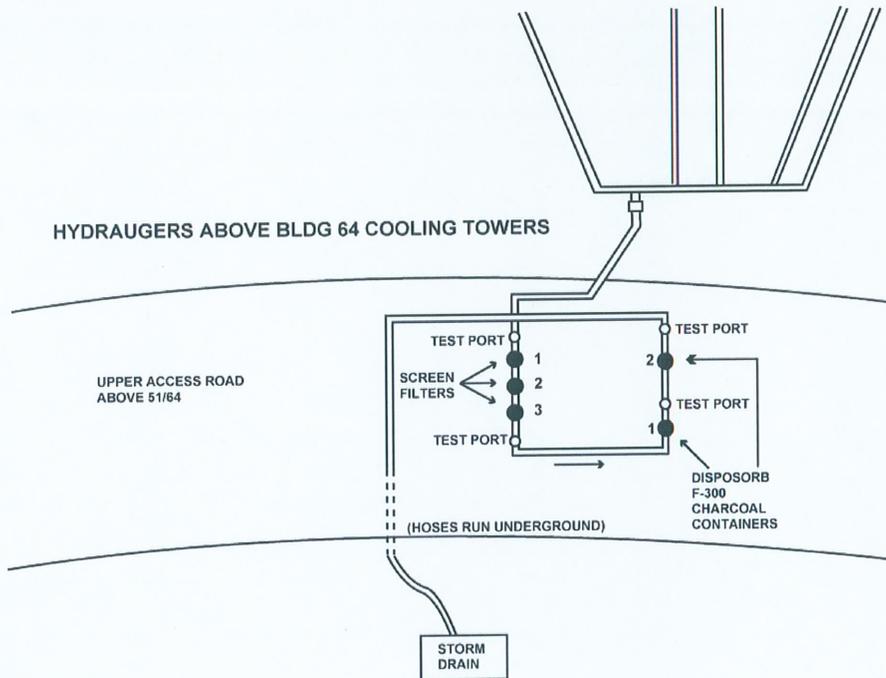

CONDITION CODE:

- 10 - No defects found
- 11 - Minor repair required
- 12 - Major repair required
- 13 - Replacement required

RESPONSIBILITIES AND CONTROLS

Rev. No.	SME/Title	REV/Title	Approved/Title	Date	Effective Date
1	<i>Michael Botello</i> Michael Botello Plant Maint Tech Lead	<i>Larry Begley</i> Larry Begley Maintenance Supervisor	<i>Ken Fletcher</i> Ken Fletcher Operations Department Head	6/11/09	6/11/09